


APPROVED SERVICE LINE SET-UP FOR 5/8" METER IN GROUND BOX

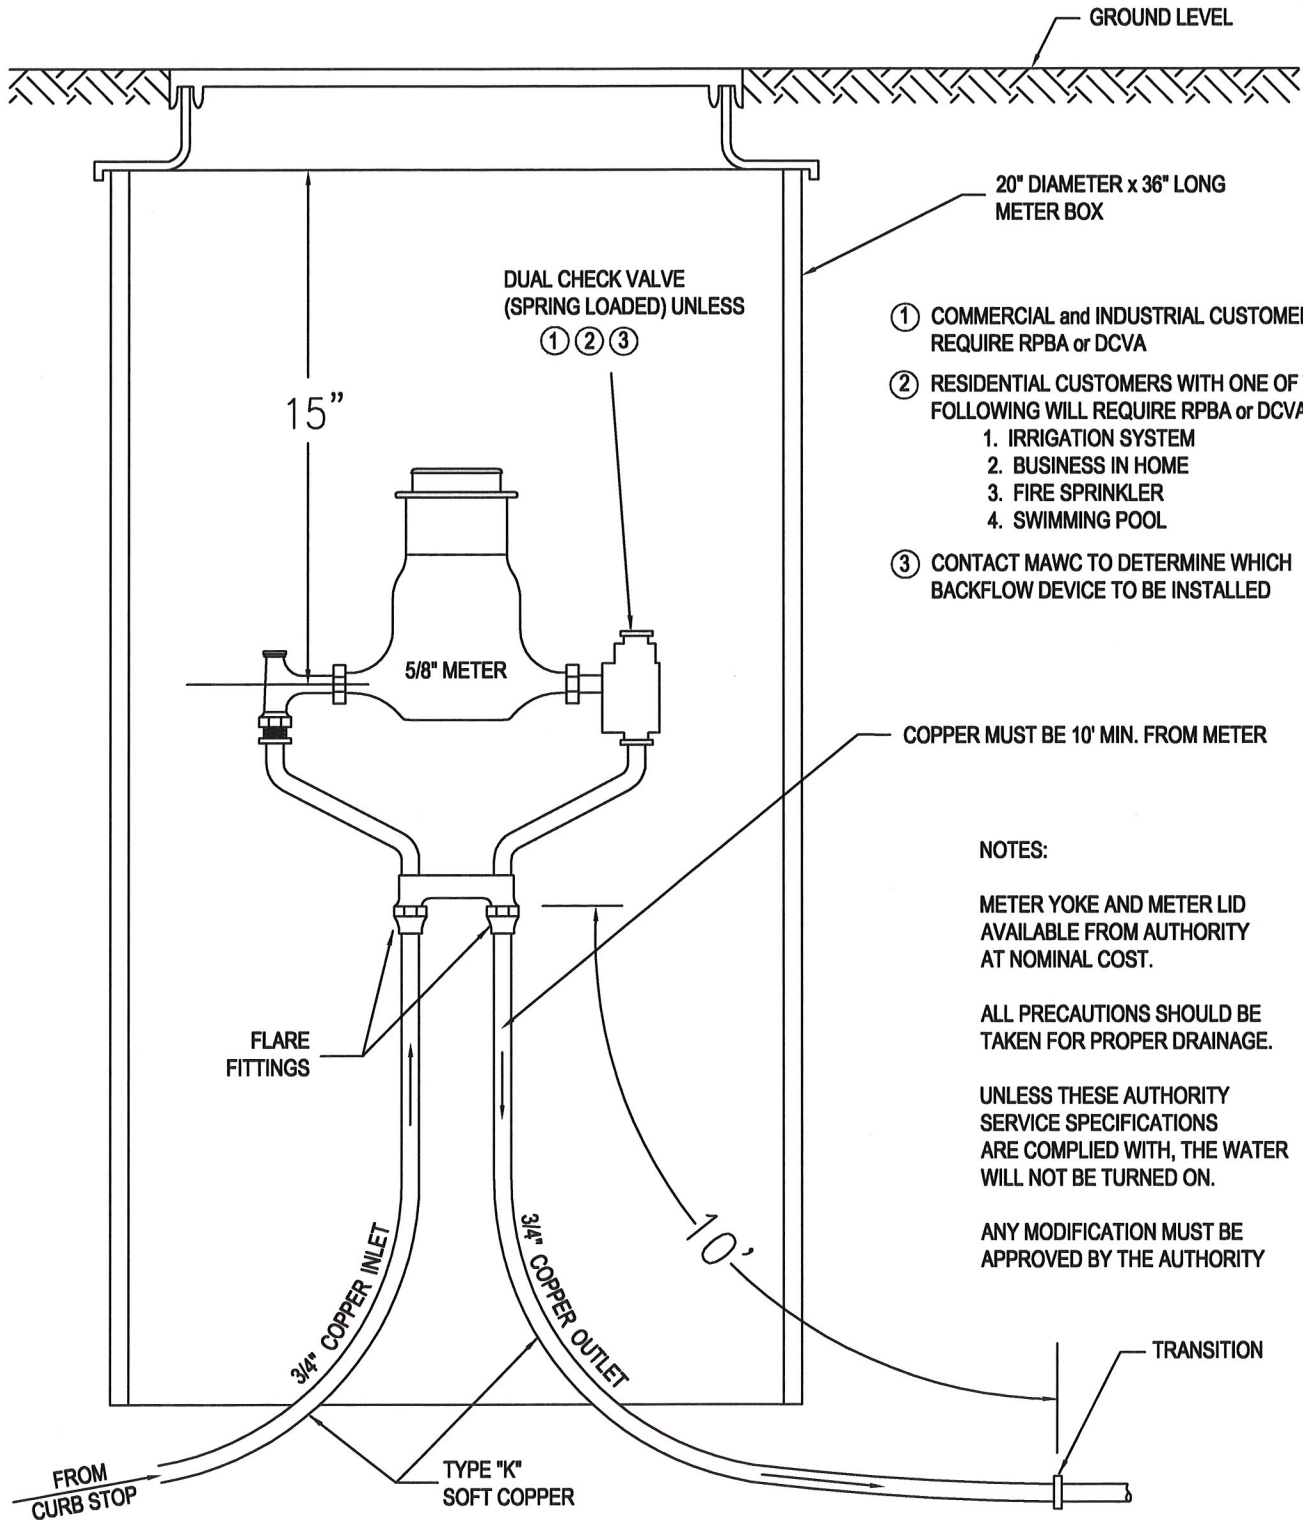

- ① COMMERCIAL and INDUSTRIAL CUSTOMERS REQUIRE RPBA or DCVA
- ② RESIDENTIAL CUSTOMERS WITH ONE OF THE FOLLOWING WILL REQUIRE RPBA or DCVA
 - 1. IRRIGATION SYSTEM
 - 2. BUSINESS IN HOME
 - 3. FIRE SPRINKLER
 - 4. SWIMMING POOL
- ③ CONTACT MAWC TO DETERMINE WHICH BACKFLOW DEVICE TO BE INSTALLED

COPPER MUST BE 10' MIN. FROM METER

NOTES:
 METER YOKE AND METER LID AVAILABLE FROM AUTHORITY AT NOMINAL COST.
 ALL PRECAUTIONS SHOULD BE TAKEN FOR PROPER DRAINAGE.
 UNLESS THESE AUTHORITY SERVICE SPECIFICATIONS ARE COMPLIED WITH, THE WATER WILL NOT BE TURNED ON.
 ANY MODIFICATION MUST BE APPROVED BY THE AUTHORITY

C:\DRAFTING\DRAWINGS\COMMERCIAL\SET-UP for 5/8" METER in GRD BOX.dwg

REVISED: JULY 3, 2013



Municipal Authority of Westmoreland County

CUSTOMER SUPPORT

724-755-5800 or 800-442-6829 Ext 5885 or 5886