




"Regional Water Wastewater Service"

## Exterior Grease Interceptor Required Elements

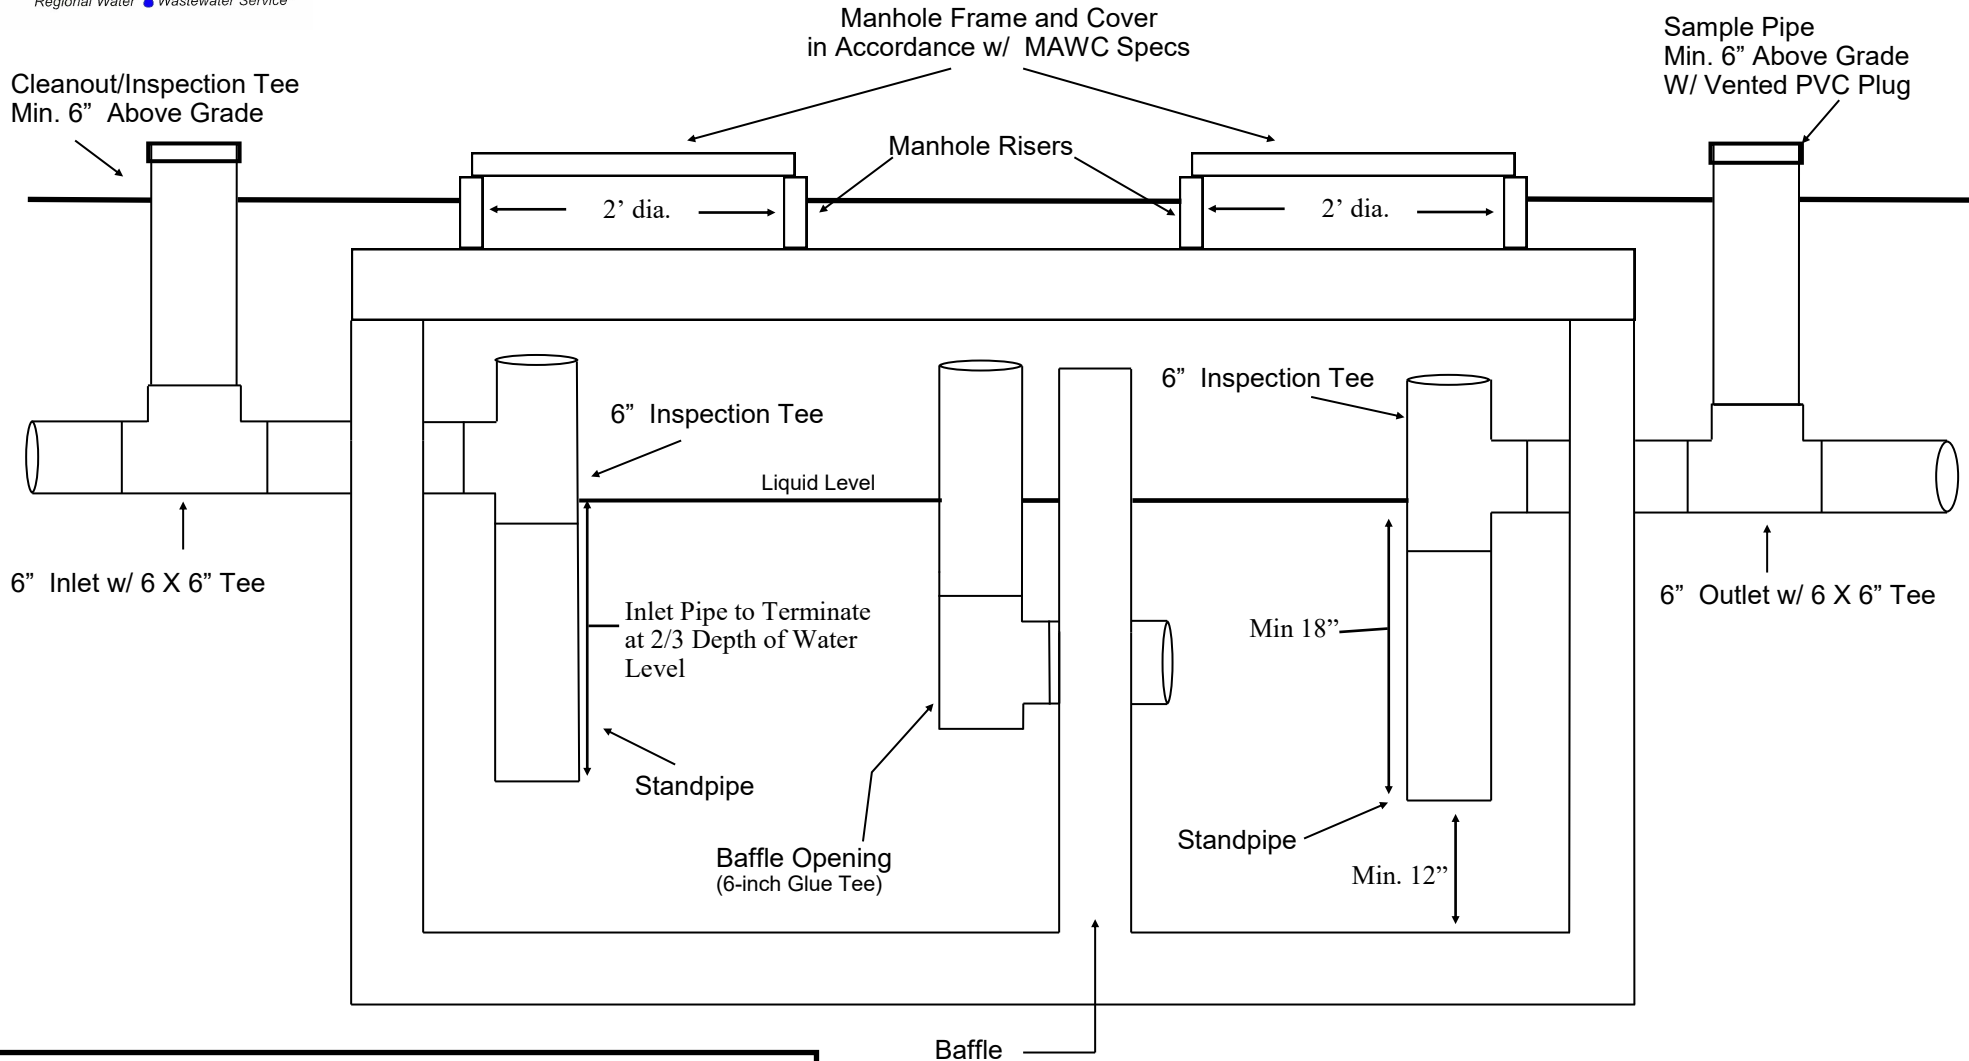

### NOTES:

1. Any Variation Of This Detail Must Be Approved By MAWC.
2. All External Pipe and Fittings Must Be 6" SDR 35 Gasket Pipe.
3. All Internal Fittings Must Be SDR Glue Type Fittings.

The Municipal Authority of  
Westmoreland County  
PO Box 730  
Greensburg, PA 15601  
724-834-0966